


MEASUREMENT SETUP





1

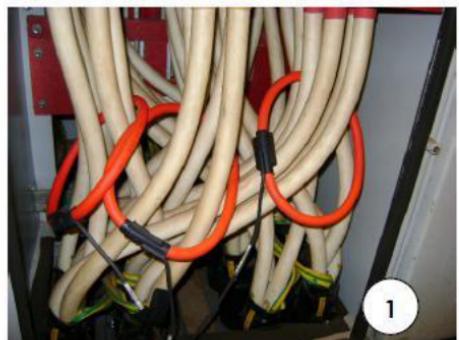

2

Pic 1 : illustrates installation of Fluke 2000 A flexible current clamp in part of load connected to the Transformer system thro 690 volt MSB, Bus B and Transformer B

Pic 2 : illustrates Dewetron Power DAQ – Dewesoft software and AREVA- Empath 2000 System

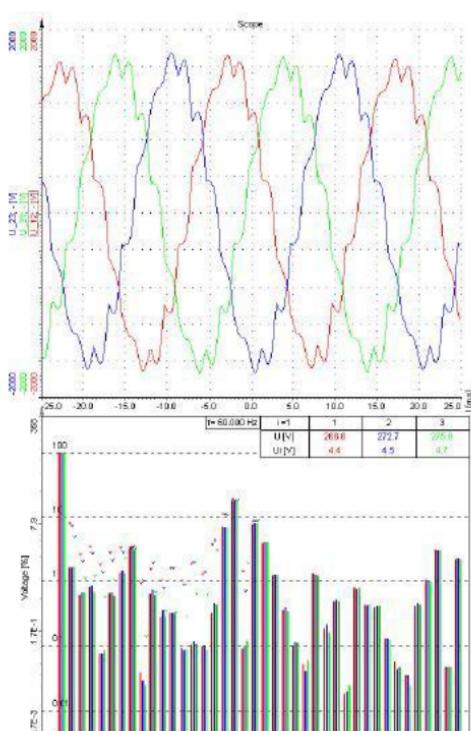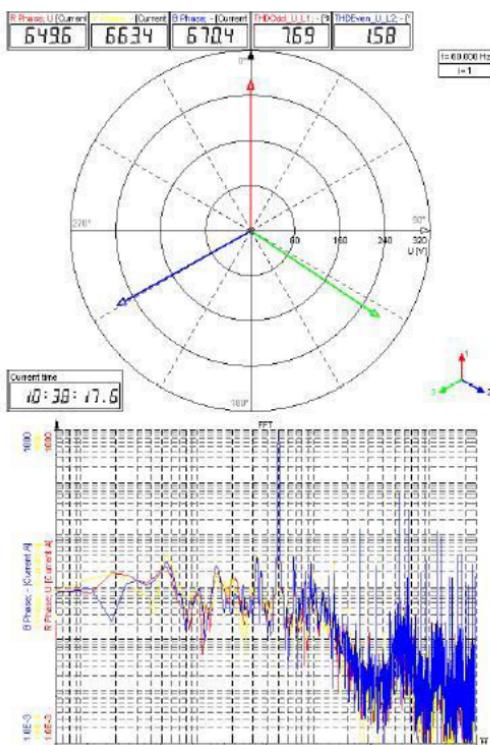

Above plot depicts the Power Harmonic Study conducted with DEWEsoft Power module